

## DECLARATION OF PERFORMANCE OF SMOKE AND HEAT CONTROL SYSTEMS

1. *Unique identification code of the product-type* **EXUBAIE V2 OFVEE**
2. *Type, batch or serial number or any other element allowing identification of the construction product as required under Article 11 paragraph 4:*  
**Information given on the tracking label :**  
**Order confirmation Number + Product Number + Date of production**

3. *Intended use or uses of the construction product, in accordance with the applicable harmonised technical specification, as foreseen by the manufacturer :*

**3.1 Product description :** Natural smoke and heat exhaust ventilator with a single casement, for wall installation on a horizontal axis in a bottom or top hung opening outside configuration, or on a vertical axis side hung opening outside style. The infill can be in cellular polycarbonate, in glass or insulated double skin aluminium (thermally or acoustically).

### 3.2 Installation and implementation conditions in accordance with the certified performances.

- Wall installation ( $\pm 30^\circ$ )
- Dimensional range : (Hht and Lht are the overall dimensions of the product)
- 

	1 MOTOR						
	BOTTOM OR TOP HUNG				Side hung		
					Avec : if Lpa ≥ 2 x Hpa		
	Minimum		Maximum		Minimum		Maximum
LHT (mm)	1020		2620	1320	1020		2620
HHT (mm)	510	745	1320	2620	510	745	1370
	Face fixed position switches	Concealed position switches			Face fixed position switches	Concealed position switches	

		2 MOTORS						
		BOTTOM OR TOP HUNG				Side hung		
						Avec : if Lpa ≥ 2 x Hpa		
		Minimum		Maximum		Minimum		Maximum
LHT (mm)		420		2620	1320	2320		2620
HHT (mm)	1220 Face fixed position switches	1355 Concealed position switches		1320	2620	1220 Face fixed position switches	1355 Concealed position switches	1370

### 3.3 Mode of operation : Electrical opening and closing

Voltage  $U_a = U_c = 24$  Vcc

Wattage  $P_a = P_c$  absorbed in a steady state 40,8 W maxi

### 3.4 Possible options :

Open / Close position switches

Thermal device release (according to the current standard).

4. *Name, registered trade name or trade mark , in conformity with article 11, paragraph 5:*

**Company name :** SOUCHIER – BOULLET SAS

Parc Segro – 42 rue de Lamirault

CS 20762

77090 COLLEGIEN

France

**Production unit :** SOUCHIER-BOULLET SAS

11 rue du 47<sup>ème</sup> R.A.

70400 HERICOURT

France

6. *7. System or systems of assessment and verification of constancy of performance of the construction product as set out in Annex V:*

The notified body TÜV Rheinland N° 0336 performed the determination of the product type on the basis of type testing, type calculation of the product, the initial inspection of the manufacturing plant and the factory production control and the continuous surveillance, assessment and evaluation of the factory production control under system 1 and issued the certificate of constancy of performance EN 12 101-2 2003

**CE Certificate N°0336 – CPR – 6742-3.**

## DECLARATION OF PERFORMANCE OF SMOKE AND HEAT CONTROL SYSTEMS

### 9. Declared performances :

Harmonised technical specification: EN 12101-2:2003	Essential characteristics	Performance
	Nominal activation conditions / sensitivity, as:	
	Initiation device	present
	Opening mechanism	present
	Inputs and outputs	present
	Response delay (response time), as:	
	Reliability	≤ 60 s
	Opening under (snow, wind) load	
	Low ambient temperature	
	Fire Performance	
	Operational reliability, as:	
	Reliability	Re 1000 (+10 000), Type B
	Effectiveness of smoke/hot gas extraction, as:	
	Aerodynamic free area (see diagrams)	$A_a = A_v \times C_v^{**}$
	Performance parameters under fire conditions, as:	
	Resistance to heat	B <sub>300</sub> 30
	Mechanical stability	$\Delta A_{throat} < 10 \%$
	Reaction to fire	
	Insulated panel or glass	A1
	Polycarbonate	B-s1;d0
	Performance under environmental conditions, as:	
	Opening under load	SL NPd
	Low ambient temperature	T(00)
	Stability under wind load	WL 1500
	Resistance to wind-induced vibration (where included)	$\omega_0 > 10\text{Hz}$ , $\delta > 0,1$
	Resistance to heat	B <sub>300</sub> 30
	Durability, as:	
	Response delay (response time)	≤ 60 s
	Operational reliability	Re 1000 (+10 000)
	Performance parameters under fire conditions	≤ 60 s; $\Delta A_{throat} < 10 \%$

#### Calculation of the free aerodynamic area:


$$A_a = A_v \times C_v^{**}$$

$$A_v = L_{pa} \times H_{pa}$$


$$L_{pa} = L_{ht} - 0,120 \text{ m and } H_{pa} = H_{ht} - 0,120 \text{ m}$$

#### Calculation of the flow coefficient $C_v$

##### On the outside in a bottom or top hung opening

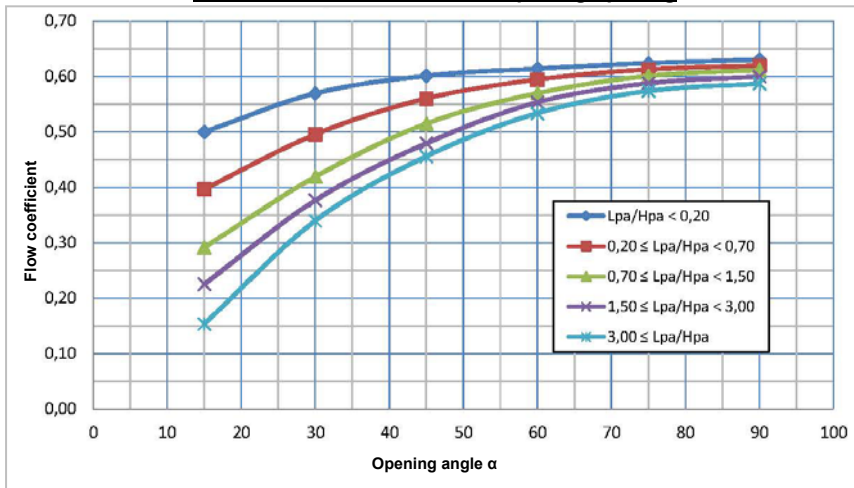

##### Outwards side hung opening

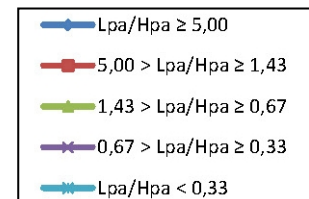

10. The performance of the product identified in points 1 et 2 is in conformity with the declared performance in point 9. This declaration of performance is issued under the sole responsibility of the manufacturer identified in point 4.

Signed for and on behalf of the manufacturer by : David Maillart – R&D Manager

The 13/04/2023  
In Collégien

