

DECLARATION OF PERFORMANCE OF SMOKE AND HEAT CONTROL SYSTEMS

- Unique identification code of the product-type: **EXUBAIE V2 OFVPE**
- Type, batch or serial number or any other element allowing identification of the construction product as required under Article 11 paragraph 4: **Information given on the tracking label :**

Order confirmation Number + Product Number + Date of production

- Intended use or uses of the construction product, in accordance with the applicable harmonised technical specification, as foreseen by the manufacturer :

3.1 Product description : Natural smoke and heat exhaust ventilator with a single casement, for wall installation on a horizontal axis on the outside in a bottom or top hung opening configuration, or on a vertical axis outwards side hung opening style. The infill can be in cellular polycarbonate, in glass or insulated double skin aluminium (thermally or acoustically).

3.2 Installation and implementation conditions in accordance with the certified performances.

- Wall installation ($\pm 30^\circ$)
- Dimensional range : (Hht and Lht are the overall dimensions of the product)

| 1 MOTOR : 1 TO 3 LOCKS | | | | | | | |
|------------------------|--|---------------------------------------|---------|---|--|---------------------------------------|---------|
| BOTTOM OR TOP HUNG | | | | Side hung | | | |
| | | | | With : if $L_{pa} \geq 2 \times H_{pa}$ | | | |
| | Minimum | | Maximum | | Minimum | | Maximum |
| LHT (mm) | 1120 | | 2620 | 1320 | 1120 | | 2620 |
| HHT (mm) | 620 Face fixed position switches | 855 Concealed position switches | 1320 | 2620 | 620 Face fixed position switches | 855 Concealed position switches | 1370 |

| 2 MOTORS : 1 TO 3 LOCKS | | | | | | | |
|-------------------------|--|--|---------|---|--|--|---------|
| BOTTOM OR TOP HUNG | | | | Side hung | | | |
| | | | | With : if $L_{pa} \geq 2 \times H_{pa}$ | | | |
| | Minimum | | Maximum | | Minimum | | Maximum |
| LHT (mm) | 420 | | 2620 | 1320 | 1720 | | 2620 |
| HHT (mm) | 920 Face fixed position switches | 1155 Concealed position switches | 1320 | 2620 | 920 Face fixed position switches | 1155 Concealed position switches | 1370 |

3.3 Mode of operation : Pneumatic opening and closing

- Service pressure 6 to 20 bars
- 0,12NI in opening

3.4 Possible options :

- Open / Close position switches.
Thermal device release (according to the current standard).

- Name, registered trade name or trade mark, in conformity with article 11, paragraph 5:

Company name : SOUCHIER – BOULLET SAS
Parc Segro – 42 rue de Lamirault
CS 20762
77090 COLLEGIEN
France

Production unit : SOUCHIER-BOULLET SAS
11 rue du 47^{ème} R.A.
70400 HERICOURT
France

7. System or systems of assessment and verification of constancy of performance of the construction product as set out in Annex V:

The notified body **TÜV Rheinland N° 0336** performed the determination of the product type on the basis of type testing, type calculation of the product, the initial inspection of the manufacturing plant and the factory production control and the continuous surveillance, assessment and evaluation of the factory production control under system 1 and issued the certificate of constancy of performance EN 12 101 – 2 2003

CE Certificate N°0336 – CPR – 6742-3.

DECLARATION OF PERFORMANCE OF SMOKE AND HEAT CONTROL SYSTEMS

9. Declared performances :

| Harmonised technical specification: EN 12101-2:2003 | Essential characteristics | Performance |
|---|---|---|
| | Nominal activation conditions / sensitivity, as: | |
| | Initiation device | present |
| | Opening mechanism | present |
| | Inputs and outputs | present |
| | Response delay (response time), as: | |
| | Reliability | |
| | Opening under (snow, wind) load | ≤ 60 s |
| | Low ambient temperature | |
| | Fire Performance | |
| | Operational reliability, as: | |
| | Reliability | Re 1000 (+10 000), Type B |
| | Effectiveness of smoke/hot gas extraction, as: | |
| | Aerodynamic free area (see diagrams) | $A_a = A_v^{**} \times C_v^{**}$ |
| | Performance parameters under fire conditions, as: | |
| | Resistance to heat | B ₃₀₀ 30 |
| | Mechanical stability | $\Delta A_{throat} < 10 \%$ |
| | Reaction to fire | |
| | Insulated panel or glass | A1 |
| | Polycarbonate | B-s1,d0 |
| | Performance under environmental conditions, as: | |
| | Opening under load | SL NPd |
| | Low ambient temperature | T(00) |
| | Stability under wind load | WL 1500 |
| | Resistance to wind-induced vibration (where included) | $\omega_0 > 10 \text{ Hz}$, $\delta > 0,1$ |
| | Resistance to heat | B ₃₀₀ 30 |
| | Durability, as: | |
| | Response delay (response time) | ≤ 60 s |
| | Operational reliability | Re 1000 (+10 000) |
| | Performance parameters under fire conditions | ≤ 60 s; $\Delta A_{throat} < 10 \%$ |


Calculation of the free aerodynamic surface :

$$A_a = A_v \times C_v^{**}$$

$$A_v = L_{pa} \times H_{pa}$$

$$L_{pa} = L_{ht} - 0,120 \text{ m and } H_{pa} = -0,120 \text{ m}$$

**Cv: Calculation of flow coefficient :

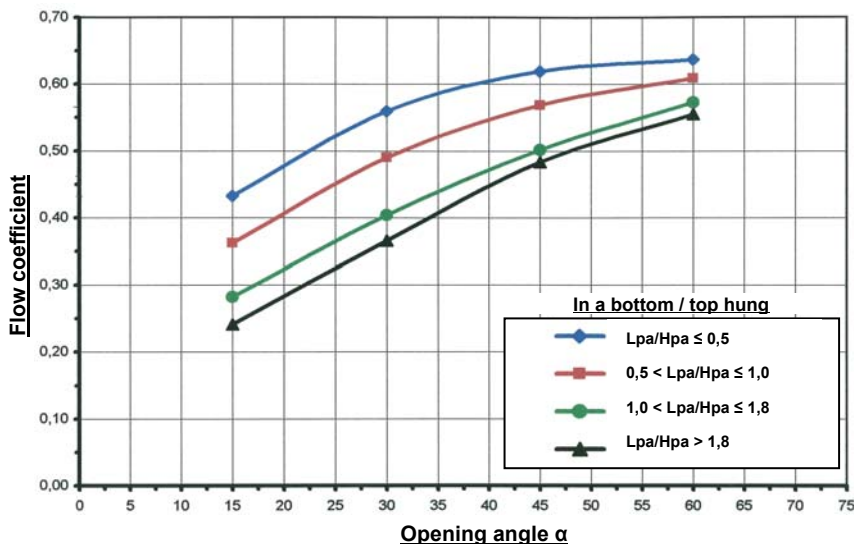

Outwards side hung opening

- $L_{pa}/H_{pa} > 1,8$
- $1,0 < L_{pa}/H_{pa} \leq 1,8$
- $0,5 < L_{pa}/H_{pa} \leq 1,0$
- $L_{pa}/H_{pa} \leq 0,5$

10. The performance of the product identified in points 1 et 2 is in conformity with the declared performance in point 9. This declaration of performance is issued under the sole responsibility of the manufacturer identified in point 4.

Signed for and on behalf of the manufacturer by : David Maillart – R&D Manager

The 13/04/2023
In Collégien

