

## DECLARATION OF PERFORMANCE OF SMOKE AND HEAT CONTROL SYSTEMS

1. *Unique identification code of the product-type:* **OTF V2 OFVPLE-OFVPE**
2. *Type, batch or serial number or any other element allowing identification of the construction product as required under Article 11 paragraph 4:*  
**Information given on the tracking label :**  

**Order confirmation Number + Product Number + Date of production**
3. *Intended use or uses of the construction product, in accordance with the applicable harmonised technical specification, as foreseen by the manufacturer :*

**3.1. Product description:** Natural smoke and heat exhaust ventilator with a single casement, for wall installation on a horizontal axis on the outside in a bottom or top hung opening configuration, or on a vertical axis, outwards side hung opening style. The infill can be in cellular polycarbonate, in glass or insulated double skin aluminium (thermally or acoustically).

**3.2. Installation and implementation conditions in accordance with the certified performance**

- Wall installation ( $\pm 30^\circ$ )
- Dimensional range: (Hht and Lht are the overall dimensions of the product)

	OFVPLE C415 Bottom or top hunged			OFVPLE C415 Side hunged			OFVPE C415 Bottom or top hunged			OFVPE C415 Side hunged		
				With : If Lpa <1800mm then Hpa> Lpa/2 If Lpa <1800mm then Hpa> Lpa/3						With : If Lpa <1800mm then Hpa> Lpa/2 If Lpa <1800mm then Hpa> Lpa/3		
	Minimum	Maximum		Minimum	Maximum		Minimum	Maximum		Minimum	Maximum	
LHT (mm)	666	2544	1744	1216	2544	1944	666	2544	1744	1216	2544	1944
HHT (mm)	666	1344	1744	666	944	1044	666	1344	1744	666	944	1044

	OFVPLE C600 Bottom or top hunged			OFVPLE C600 Side hunged			OFVPE C600 Bottom or top hunged			OFVPE C600 Side hunged		
				With : Hpa ≤ Lpa /2						With : Hpa ≤ Lpa /2		
	Minimum	Maximum		Minimum	Maximum		Minimum	Maximum		Minimum	Maximum	
LHT (mm)	444	2644	1344	1314	2644		416	1344		786	1344	
HHT (mm)	729	1644	2644	729	1394		591	2644		451	744	

**3.3. Mode of operation:** Pneumatic opening and closing  
 Service pressure 6 to 15 bars (Cylinder volume :13,52NL max)

**3.4. Possible options :**  
 Open / Close position switches  
 Thermal device release (according to the current standard).

4. *Name, registered trade name or trademark, in conformity with article 11, paragraph 5:*

**Company name :** SOUCHIER – BOULLET SAS  
 Parc Segro – 42 rue de Lamirault  
 CS 20762  
 77090 COLLEGIEN  
 France

**Production unit :** SOUCHIER SAS  
 11 rue du 47<sup>ème</sup> R.A.  
 70400 HERICOURT  
 France

6. *7. System or systems of assessment and verification of constancy of performance of the construction product as set out in Annex V :*  
 The notified body **TÜV Rheinland N° 0336** performed the determination of the product type on the basis of type testing, type calculation of the product, the initial inspection of the manufacturing plant and the factory production control and the continuous surveillance, assessment and evaluation of the factory production control under system 1 and issued the certificate of constancy of performance N°.

**CE Certificate N° 0336 – CPR – 89208434.**

## DECLARATION OF PERFORMANCE OF SMOKE AND HEAT CONTROL SYSTEMS

9. Declared performances :


Harmonised technical specification: EN 12101-2:2003	Essential characteristics	Performance
	Nominal activation conditions / sensitivity, as: Initiation device Opening mechanism Inputs and outputs	present present present
	Response delay (response time), as: Reliability Opening under (snow, wind) load Low ambient temperature Fire Performance	≤ 60 s
	Operational reliability, as: Reliability	Re 1000 (+10 000), Type B
	Effectiveness of smoke/hot gas extraction, as: Aerodynamic free area (See page 3)	$A_f = A_v^* \times C_v^{**}$
	Performance parameters under fire conditions, as: Resistance to heat Mechanical stability Reaction to fire  Panel or glass insulated Polycarbonate	$B_{100} \geq 30$ $\Delta A_{\text{thru}} < 10 \%$  A1 B-s1;d0
	Performance under environmental conditions, as: Opening under load Low ambient temperature Stability under wind load Resistance to wind-induced vibration (where included) Resistance to heat	SL NP T(00) WL 1500 NP $B_{100} \geq 30$
	Durability, as: Response delay (response time) Operational reliability Performance parameters under fire conditions	≤ 60 s Re 1000 (+10 000) ≤ 60 s; $\Delta A_{\text{thru}} < 10 \%$

**Free aerodynamic surface calculation**

$$A_a = A_v \times C_v^{**}$$

$$A_v = Lpa \times Hpa$$

**\*\* Cv: Calculation of flow coefficient:**

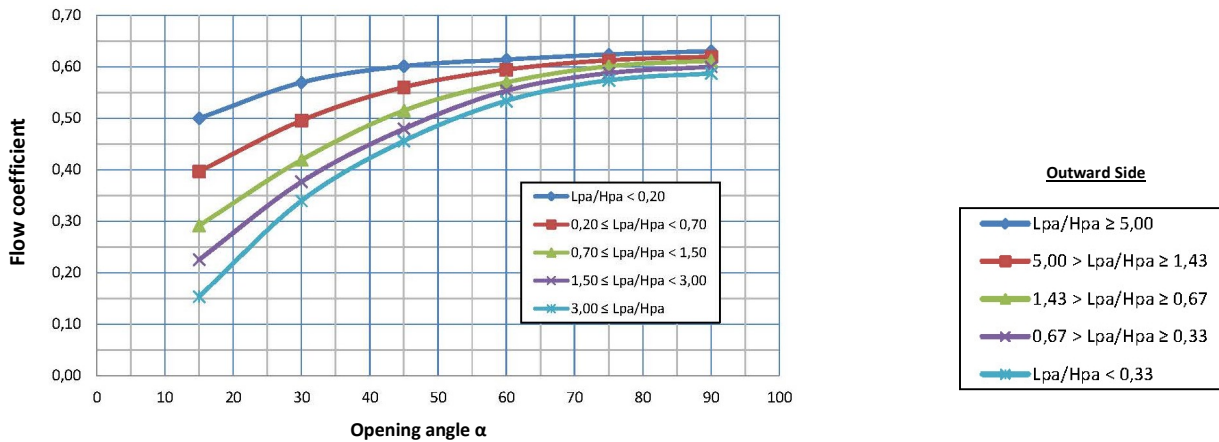

10. The performance of the product identified in points 1 et 2 is in conformity with the declared performance in point 9. This declaration of performance is issued under the sole responsibility of the manufacturer identified in point 4.

Signed for and on behalf of the manufacturer by: **David Maillart – R&D Manager**

Le 10/03/2025  
In Collégien