



N: DoP BAI OSPE_indB

DECLARATION OF PERFORMANCE OF SMOKE AND HEAT CONTROL SYSTEMS

Unique identification code of the product-type:

EXUBAIE RPT OSPE

2. Type, batch or serial number or any other element allowing identification of the construction product as required under Article 11 paragraph 4: Information given on the tracking label:

Order confirmation Number + Product Number + Date of production

- 3. Intended use or uses of the construction product, in accordance with the applicable harmonised technical specification, as foreseen by the manufacturer:
- **3.1 Product description:** Natural smoke and heat exhaust ventilator with a single casement, for wall installation on a horizontal axis on the outside in a bottom or top hung opening configuration, or on a vertical axis outwards side hung opening style. The infill can be in cellular polycarbonate, in glass or insulated double skin aluminium (thermally or acoustically).

3.2 Installation and implementation conditions in accordance with the certified performances.

- Wall installation (±5°)
- Dimensional range: (Hht and Lht are the overall dimensions of the product)

 $0.5 \le Hht \le 1.6 \text{ m}$ and $0.5 \le Lht \le 2.4 \text{ m}$.

With $0,10 \le A_v^* \le 2,16 \text{ m}^2$

* Exubaie RPT OSPE: A_v = Lpa x Hpa (Lpa = Lht – 0,212 m and Hpa = Hht – 0,212 m)

3.3 Mode of operation: Pneumatic opening only

Service pressure 6 to 20 bars (cylinder volume 0,12Nl under 10

bars)

3.4 Possible options :

Open / Close position switches

Thermal device release (according to the current standard).

4. Name, registered trade name or trademark, in conformity with article 11, paragraph 5:

Company name: SOUCHIER – BOULLET SAS Parc Segro – 42 rue de Lamirault CS 20762

77090 COLLEGIEN

France

6.

Production unit: SOUCHIER SAS 11 rue du 47^{ème} R.A. 70400 HERICOURT France

7. System or systems of assessment and verification of constancy of performance of the construction product as set out in Annex V:

The notified body **TÜV Rheinland N° 0336** performed the determination of the product type on the basis of type testing, type calculation of the product, the initial inspection of the manufacturing plant and the factory production control and the continuous surveillance, assessment and evaluation of the factory production control under system 1 and issued the certificate of constancy of performance N°

CE Certificate N°0336 - CPR - 6742-3.

9. <u>Declared performances</u>:

Essential characteristics	Performance
Nominal activation conditions / sensitivity, as:	
Initiation device	present
Opening mechanism	present
Inputs and outputs	present
Response delay (response time), as:	16.7
Reliability	
Opening under (snow, wind) load	≤ 60 s
Low ambient temperature	2003
Fire Performance	
Operational reliability, as:	
Reliability	Re 1000, Type A
Effectiveness of smoke/hot gas extraction, as:	
Aerodynamic free area (See page 2)	$A_a = A_v^* \times C_v^{**}$
Performance parameters under fire conditions, as:	100 to 10
Resistance to heat	B ₃₀₀ 30
Mechanical stability	ΔA _{throat} < 10 %
Reaction to fire	
Panel or glass insulated	A1
Polycarbonat	B-s1;d0
Performance under environnemental conditions, as:	
Opening under load	SL NPD
Low ambient temperature	T(00)
Stability under wind load	WL 1500
Resistance to wind-induced vibration (where included)	NPD
Resistance to heat	B ₃₀₀ 30
Durability, as:	
Response delay (response time)	≤ 60 s
Operational reliability	Re 1000
Performance parameters under fire conditions	≤ 60 s: ΔA _{thron} < 10 %

Calculation of the free aerodymanic surface:

Aa = Av x Cv** Av = Lpa x Hpa













N : DoP BAI OSPE_indB

DECLARATION OF PERFORMANCE OF SMOKE AND HEAT CONTROL SYSTEMS

** Cv : Calculation of flow coefficient :

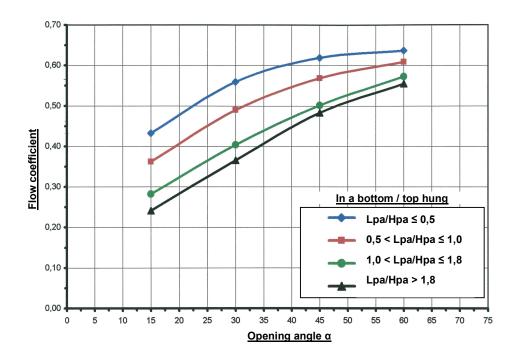



10. The performance of the product identified in points 1 et 2 is in conformity with the declared performance in point 9. This declaration of performance is issued under the sole responsibility of the manufacturer identified in point 4.

Signed for and on behalf of the manufacturer by: David Maillart - R&D Manager

The 25/03/2024 In Collégien





