



Kiwa Nederland B.V.
 Sir Winston Churchilllaan 273
 2288 EA Rijswijk
 The Netherlands
 www.kiwa.nl



European Technical Assessment

**ETA 17/0974
 of 15/05/2018**

General Part

Technical Assessment Body issuing the ETA: Kiwa Nederland B.V., Sir Winston Churchilllaan 273, 2288 EA Rijswijk, www.kiwa.nl	
Trade name of the construction product	ALSAN 600
Product family to which the construction product belongs	Liquid applied roof waterproofing kit on the basis of polyurethane
Manufacturer	Soprema SAS 14 Rue de Saint-Nazaire 67025 Strasbourg France
Manufacturing plant(s)	Soprema SAS 14 Rue de Saint-Nazaire 67025 Strasbourg France
This European Technical Assessment contains	7 pages including 2 Annex(es) which form an integral part of this assessment.
This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of	Guideline for European technical approval of "Liquid applied roof waterproofing kits", ETAG 005 Part 6: "Specific stipulations for kits based on polyurethane, version March 2000, Revision March 2004, used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011.

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission according to Article 25 Paragraph 3 of Regulation (EU) No 305/2011.

Specific parts

1. Technical description of the product

The liquid applied roof waterproofing kit “ALSAN 600” is a kit, which consists of the components

- No Primer or Primer “ALSAN 140” on the basis of a two-component polyurethane primer or Primer “ALSAN 130” on the basis of a two-component waterborne epoxy resin
- Fleece “ALSAN Fleece GF” which is a glass fibre reemat or “ALSAN Fleece B” which is a one side burned polyester fleece, or without an inlay
- Water proofing membrane “ALSAN 600” on the basis of a single component polyurethane for waterproofing layers on roofs

For an adequate adhesion of the waterproofing layer – depending on the type of substrate – a primer is required. In general the primer belonging to the substrate is given in the manufacturer technical documents. In single cases the manufacturer is responsible to give guidance which pre-treatment / primer is required.

The minimum applied layer thickness of the roof waterproofing membrane is 2.5 mm for use of polyester fleece, 2.0 mm for use of glass fibre reemat and 1.4 mm for the use without inlay.

As an assembled system these components form a homogeneous seamless roof waterproofing kit.

The components and the system build-up of the roof waterproofing kit “ALSAN 600” are given in Annex A.

2. Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

The product is used for the waterproofing of roof surfaces against penetration of atmospheric water.

In the technical file the manufacturer give information concerning the substrates which the product is suitable for and how these substrates shall be pre-treated. It comprises all necessary information for the production and the installation and repair of the kit and is deposited at Kiwa.

The levels of use categories are given in Annex A.

The verification and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the product of at least 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

The levels of use categories and performances given in Section 3 are only valid if the liquid applied roof waterproofing is used in compliance with the specification and conditions given in Annex B and the installation of the manufacture stated in the technical file.

3. Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Not applicable

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
External fire performance	See Annex A
Reaction to fire	See Annex A

3.3 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Water vapour permeability	See Annex A
Watertightness	See Annex A
Release of dangerous substances	No performance determined
Resistance to mechanical damage (perforation)	See Annex A, use categories
Resistance to plant roots	See Annex A

3.4 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Resistance to wind loads	See Annex A
Slipperiness	See Annex A

3.5 Protection against noise (BWR 5)

Not applicable

3.6 Energy economy and heat retention (BWR 6)

Not applicable

3.7 Sustainable use of natural resources (BWR 7)

For the sustainable use of natural resources no performance was investigated for this product

3.8 General aspects

The verification of durability and serviceability is part of testing the essential characteristics. Durability and serviceability is only ensured if the specifications of intended use according to Annex B and the specification of the technical file of the manufacturer are kept.

4. Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

According to Decision of the Commission of 12 October 1998 (98/599/EC) (OJ L 287 of 24.10.98, p.30) as amended by Decision of the Commission of 8 January 2001 (2001/596/EC) (OJ L 209 of 02.08.2001, p33), the system of assessment and verification of constancy of performance (see Annex V and Article 65 Paragraph 2 to Regulation (EU) No 305/2011) given in the following table applies.

Product	Intended uses(s)	Level or class	System
Liquid applied roof waterproofing kits	For uses subject to external fire performance regulations	-	3
	For uses subject to reaction to fire	E	
	All other roof waterproofing uses all other characteristics	-	


5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down on the control plan deposited at Kiwa.

Issued in Rijswijk on 15.05.2018

By Kiwa NL

Annex A

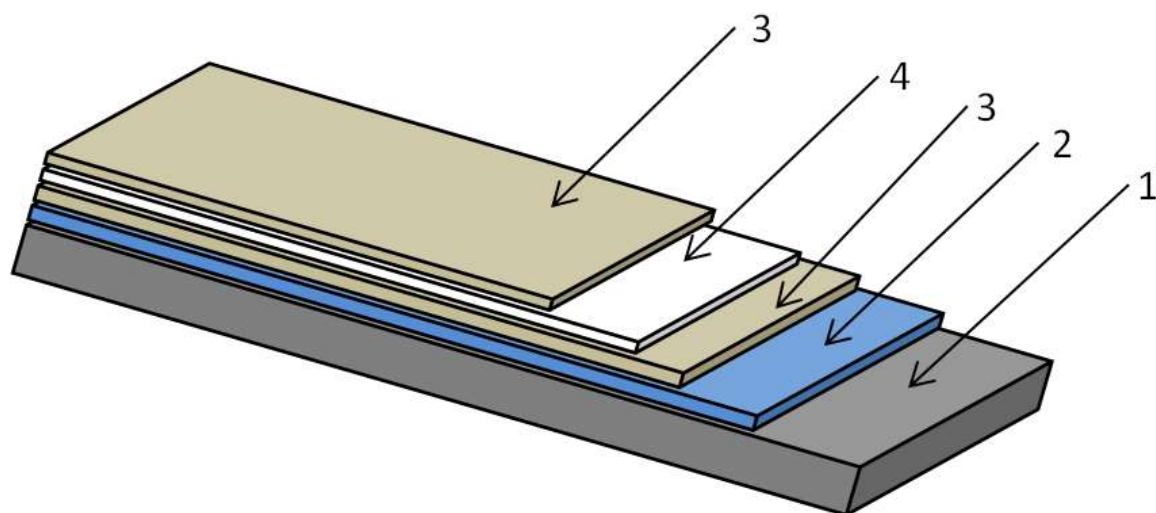

1: Substrate

2: Primer if needed – ALSAN 140 or ALSAN 130

3: waterproofing layer – ALSAN 600

4: Inlay – ALSAN Fleece GF or ALSAN Fleece B or without inlay

Classification of the roof waterproofing system “ALSAN 600”

	ALSAN Fleece B	ALSAN Fleece GF	Without Inlay
Minimum consumption	3.0 kg/m ²	2.0 kg/m ²	1.6 kg/m ²
Minimum layer thickness	2.5 mm	2.0 mm	1.4 mm
Classification to use categories according to ETAG 005:			
Working life	W3 (25 years)		W2 (10 Years)
Climatic zones	M and S (moderate and severe climate)		
Resistance to mechanical damage (perforation)	Compressible and non-compressible substrates: P1 to P4 (from low to special)		P1 to P3 (from low to normal)
Roof slope	S1 to S4 (each roof slope)		
Lowest surface temperature	TL4 (-30 °C)		TL4 (-30 °C)
Highest surface temperature	TH4 (90 °C)		TH3 (80 °C)
Use category regarding BWR 3	S/W 2		
Performances of the product:			
Reaction to fire EN 13501-1	Class E		
External fire performance EN 13501-5	No performance determined		
Water vapour diffusion resistance factor	μ = 8022	μ = 5800	μ = 1530
Watertightness	passed		
Release of dangerous substances	See chapter 3.3		
Root resistance	No performance determined		
Resistance to wind loads	≥ 50 kPa for tear-resistant substrates		
Slipperiness	No performance determined		

Annex B

Installation

The levels of use categories and the performance of the roof waterproofing can be assumed only, if the installation is carried out according to the installation instructions stated in the technical file of the manufacturer, in particular taking account of the following points:

- installation by appropriately trained personnel,
- installation of only those components which are marked components of the kit,
- installation with required tools and adjuvants,
- precautions during installation,
- inspecting the roof surface for cleanliness and correct preparation,
- inspecting compliance with suitable weather and curing conditions,
- ensuring a thickness as stated above of the cured waterproofing referring to the used reemat,
- inspections during installation and of the finished product and documentation of the results